

USER'S MANUAL OF DUCT TYPE ELECTRICAL HEATER

APPLIED TO MODELS

AS-EC35

AS-EC65

AS-EC100

AS-EC100F(HF-250H)

AS-EC100F(HF-250H-A)



Attention
Please read this manual carefully before using the equipment



Safety Considerations

Please read the following safety instructions before installation. And ensure that the unit is installed correctly.

Please observe all instruction in order to avoid any injury or damage to equipment or property.

Safety attentions

The following symbols indicate potential levels of caution.



Situations with a risk or death or serious injure.



Situations with a risk of injury or equipment/property damage.

The following symbols indicate compliance which must be observed



Not allowed or Stop



Must follow



or obliged

Warning

- Installation to be carried out by qualified person, End Users must not install, move or re-install this equipment by themselves
- An anti-bird net or similar device should be installed to outside vents. Ensure there are no obstructions to or in the ducts
- Installation engineers must follow this manual strictly. Improper action can create a health hazard and reduce efficiency of the unit
- Fresh air vent must be far enough away from any flue gas discharge or areas where hazardous vapors are present
- Unit must be installed strictly following this manual and mounted to a weight bearing surface for the weight of the unit
- Electric engineering must follow national regulations and the manual, use special cables. Less capacity cables and improper engineering can cause electric shock or fire.
- During maintenance or repair, the unit and circuit breaker must be switched off. Otherwise electric shock could occur.
- Ground wire cannot be connected to gas pipe, water pipe, lighting rod or telephone line etc. Incorrect grounding can cause electric shock.

\triangle

Attention

- Power cable and wires must be installed by a qualified electrical engineer. Improper connection can cause over heating. Fire and loss of efficiency.

To avoid condensation, insulation should be fitted to fresh air ducts. Other ducting may also require insulation depending on dew point conditions.

- Insulation between the metal ducting and wall penetration must be installed if the ducting penetrates metal wall cladding, to avoid risk of electric shock or current leakage.
- ①

The cover of wiring box must be pressed down and closed to avoid dust and dirt entering. Excess dust and dirt can cause overheating of terminals and result in fire or electric shock.

- Use only approved installation hardware and accessories. Failure to observe can result in fire risk, electric shock and equipment failure

Where the unit is positioned, at high level in a hot humid situation. Please ensure sufficient ventilation is available

- The outdoor ducts must be installed facing downwards to avoid rain water entering. Improper installation can cause water leakage.
- (!)

Correctly sized MCB must be fitted to the unit suitable earth leakage protection should also be installed to avoid risk of electric shock or fire.

Safety Considerations

Safety Considerations


Attention									
(!)	Do not install the unit in an extremely humid conditions, as it may result in electric shock and pose a fire risk.		Do not use the units as the primary kitchen extract grease and fatty deposits can block the heat exchanger, filter and pose a fire risk.						
(1)	Don not install the unit in areas there any poisonous or caustic gases are present.	\odot	Do not install the unit near open flame as it may result in over heating and pose a fire risk						
(!)	Acidic or alkali environments can cause poisoning or a fire	\odot	Rated supply voltage must be maintained, otherwise this may cause fire.						

Warning									
(!)	physical, sensory or mental capabilities or I	ack of e	B years and above and persons with reduced experience and knowledge if they have been the appliance in a safe way and understand						
(1)	Children shall not play with the appliance.	①	Cleaning and user maintenance shall not be made by children without supervision.						
(1)	Means for disconnection must be incorporated in the fixed wiring in accordance with the wiring rules.	1	Prior to cleaning or other maintenance, the appliance must be disconnected from the supply mains.						

Installation Considerations

Installation attentions

- 1. The duct type electrical heater should be installed between the ducts of air conditioning units or heat recovery ventilator, to preheat the incoming air and to avoid the problem of over low temperature of supply air.
- 2. Protection to the unit must be made to avoid construction dust or detritus entering the unit if the unit will be kept either long or short time in the installation site.
- 3. Unit cannot be installed nearby the water heater.
- 4. Following phenomenon should be avoided in duct installation.



- 5. Unit should be connected with other ventilation equipments by the ducts, no air ports should be reserved between the equipments.
- 6. Unit should be fasten on the hook housing of steel plate, and insulated by non-combustible insulation material.
- 7. The flange gasket between the duct connection should be made by heat-resisting and non-combustible materials.
- 8. If the size of the vent of unit do not match those of duct system, use the reducer pipe for transition. The reducer should be made according to the ventilation ducting design regulation (the angle between duct and reducer should be less than 15 degree).
- 9. The main duct should install the air valve to regulate the airflow, to make sure each fan in series doesn't run at overload status. The bigger airflow, the higher load of fans.

Electrical Installation





Power must be cut off before installation and maintenance to avoid injury by electric shock. The specifications of cables must strictly match the requirements, otherwise it may cause performance failure and danger of electric shock or fire.


- 1. The power supply is AC220V/50Hz/1ph.
- 2. Unit should be well-grounding.
- 3. The wiring terminals exposed should be protected by cover.
- 4. The electrical heater can only be used under ventilation status. The ON/OFF of electrical heater should be locked with fans.
- 5. Open the cover of electrical box, connect the 2 wires (L/N) to the terminals.


Model	Specification of power supply cable				
AS-EC35	2×1.5mm ²				
AS-EC65	2×1.5mm ²				
AS-EC100	2×2.0mm ²				
AS-EC100F (HF-250H)	2×2.5mm ²				
AS-EC100F (HF-250H-A)	2×2.5mm ²				

Dimensions

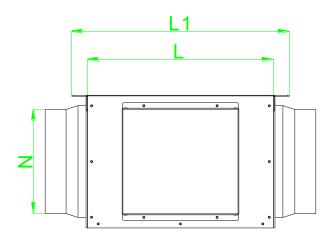



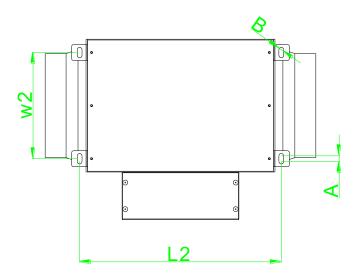




Mode1	L1	L	Н	W	W1	W2	L2	В	A	N
AS-EC35	410	350	270	280	90	230	380	9	11	145
AS-EC65	410	350	250	250	90	200	380	9	11	196
AS-EC100	460	400	324	324	90	234	430	9	11	245
AS-EC100F (HF-250H)	460	400	324	324	90	234	430	9	11	245
AS-EC100F (HF-250H-A)	460	400	324	324	90	234	430	9	11	245

Wiring Diagram and Technical Parameters

Wiring diagram

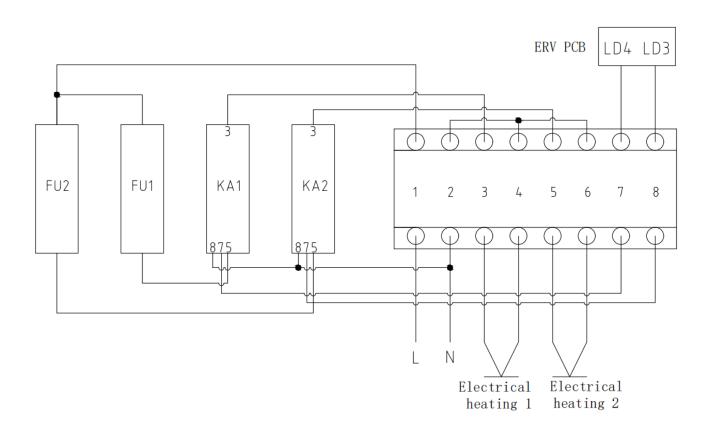

Technical parameters

Model	Rated Air- flow	Power Consumption (kw)		Heating power (kw)		Temp. rise(°C)		Volt (V)	Frequency	
	(m^3/h)	Low	High	Low	High	Low	High		(Hz)	
AS-EC35	350	0.6	1.1	0.5	1.0	5.0	10.0	220	50	
AS-EC65	650	0.9	1.7	0.8	1.6	5.0	10.0	220	50	
AS-EC100	1000	1.3	2.5	1.2	2.4	5.0	10.0	220	50	
AS-EC100F (HF-250H)	1000-1300	1.5	2.9	1.4	2.8	5.0	10.0	220	50	
AS-EC100F (HF-250H-A)	1000-1300	1.8	3.5	1.7	3.4	5.0	10.0	220	50	

Guangzhou Airwoods Environment Technology Co., Ltd.

Address: Room 2101, No. 25 Headquarter Center, Tian An Ecological Park, No.555 Panyudadao North Road, Guangzhou, China (511400)

Tel: 0086-20-39388201 Fax: 0086-20-39388202 Web: www.airwoods.com Email: info@airwoods.com